



A CANARM COMPANY

523 James Street, Delhi, Ontario, Canada N4B 2Z3
 Tel #: 519-582-2440, Fax #: 519-582-0581
 Internet: www.delhi-industries.com

MODEL - BTA

Belt driven tube axial fan c/w cast aluminum propeller

All dimensions are in inches.



| MODEL # | A | B | C | D | E | F |
|---------|--------|--------|----|---------|------|--------|
| BTA12 | 12 | 15 1/8 | 17 | 3/4 | 3/16 | 14 |
| BTA15 | 15 3/8 | 18 3/8 | 17 | 3/4 | 3/16 | 17 |
| BTA18 | 18 3/8 | 21 3/8 | 18 | 1 | 1/4 | 20 |
| BTA24 | 24 3/8 | 27 3/8 | 21 | 1 3/16 | 1/4 | 25 7/8 |
| BTA30 | 30 3/8 | 33 3/8 | 21 | 1 7/16 | 3/8 | 32 3/8 |
| BTA34 | 34 3/8 | 37 3/8 | 27 | 1 7/16 | 3/8 | 36 3/8 |
| BTA36 | 36 3/8 | 39 3/8 | 27 | 1 7/16 | 3/8 | 38 3/8 |
| BTA42 | 42 3/8 | 45 3/8 | 27 | 1 7/16 | 3/8 | 44 3/8 |
| BTA48 | 48 3/8 | 51 3/8 | 31 | 1 15/16 | 1/2 | 50 3/8 |
| BTA54 | 54 3/8 | 58 3/8 | 40 | 1 15/16 | 1/2 | 56 3/8 |
| BTA60 | 60 3/8 | 64 3/8 | 40 | 1 15/16 | 1/2 | 62 3/8 |

Standard Features

- Cast aluminum propeller 12" - 48" models
- Polypropylene reinforced fiberglass propeller on 54" & 60" models
- Heavy duty painted steel housing
- Cast pillow block bearings
- Extended lube lines
- Anti static belts
- TEFC motors
- Factory assembled to required performance

Accessories

- A - Disconnect switch
- B - Inlet / outlet guards
- C- Companion rings
- D - Support clips
- E - Support legs
- F - Motor and belt covers
- G - Belt guard
- H - Inspection door
- I - Specials

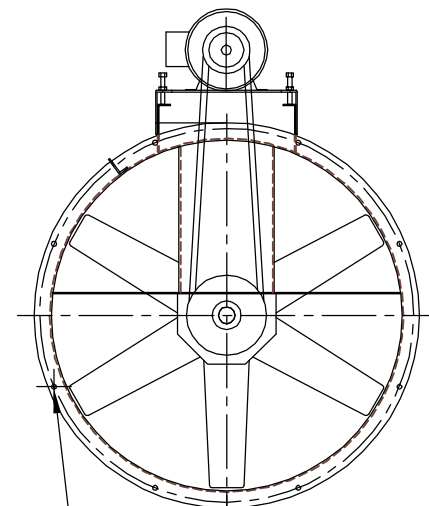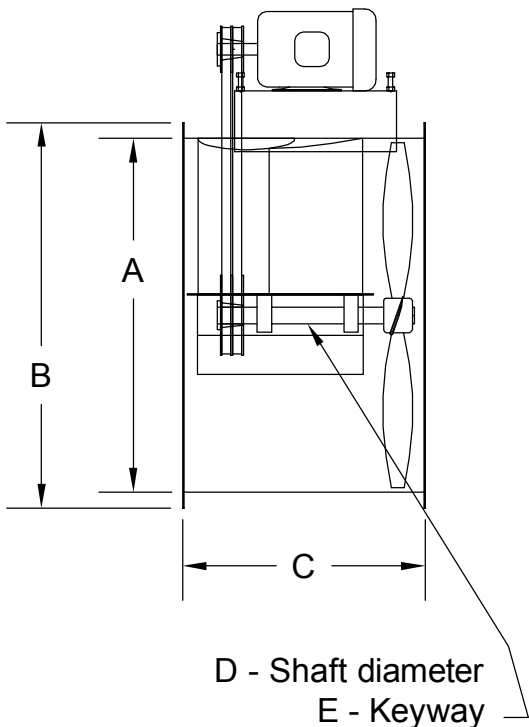

8 typ $\varnothing \frac{7}{16}$ " holes on "F" bolt circle

NOTE: 24" model has 6 holes equally spaced on "F" bolt circle.

See our web site at www.delhi-industries.com or contact our factory for all current submittal drawings. Delhi Industries will not be responsible for fabrication changes or errors resulting from customer use of a non-current submittal drawing.

| FAN DATA | | | | | | MOTOR DATA | | | | | | ACCESSORIES & REMARKS |
|----------|------|-----------|-----|----|-----|------------|-----|-------|----|----|-----------|-----------------------|
| FAN NO. | QTY. | MODEL NO. | CFM | SP | RPM | HP | RPM | VOLTS | PH | HZ | ENCLOSURE | |
| | | | | | | | | | | | | |
| | | | | | | | | | | | | |
| | | | | | | | | | | | | |
| | | | | | | | | | | | | |

PROJECT _____ ENGINEER _____ SUBMITTED BY _____ DATE _____
 LOCATION _____ CONTRACTOR _____ APPROVED BY _____ DATE _____
 FORM NO. _____ REVISION DATE _____

REVISION - 1 DATE - 07-24-07